



Product Data Sheet

FILMTEC™ BW60-1812-75 Element

Next Generation of Residential Reverse Osmosis Elements

Description

FILMTEC™ Residential Elements are some of the most reliable, consistent and highest quality in the industry just got even better. Our 75 GPD elements offer the best balance of flow and highest rejection available in the market.

New FILMTEC™ Residential Elements feature:

- New membrane (BW60) chemistry produces industry leading 99% stabilized salt rejection.
- Even longer lifetimes on high hardness water applications
- Even faster start-up to reach stabilized rejection
- High active membrane area and twin leaf design for optimized performance
- NSF58 safety Certification and reduced certification costs / resources with NSF data transfer Certification
- Fully-automated manufacturing that ensures consistent and high quality elements
- Dry shipping for convenient handling and longer shelf-life
- Proven consistency and reliability for longer membrane life

Product Type


Spiral-wound element with polyamide thin-film composite membrane

Typical Properties

| FILMTEC™ Element | Applied Pressure | | Permeate Flow Rate | | Typical Stabilized Salt Rejection (%) |
|---------------------|------------------|-------|--------------------|-------|---------------------------------------|
| | (psig) | (bar) | (GPD) | (l/h) | |
| BW60-1812-75 | 50 | 3.4 | 75 | 12 | 99 |

1. Permeate flow and salt rejection based on the following test conditions: 250 ppm softened tap water, 77°F (25°C), 15% recovery and the specified applied pressure.
2. Minimum salt rejection is 96.0%.
3. Permeate flows for individual elements may vary ±20%.

Element Dimensions

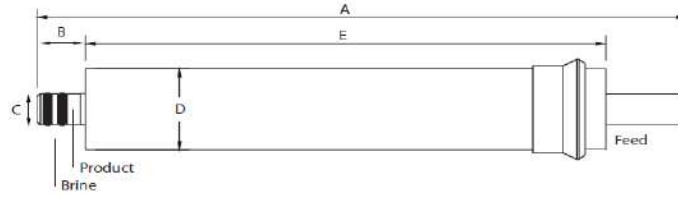

COMPONENT

This component is Tested and Certified by NSF International against NSF/ANSI Standard 58 for material requirements only.

| FILMTEC™ Element | A | | B | | C | | D | | E | |
|---------------------|-------|-------|-------|------|-------|------|-------|------|-------|------|
| | (inc) | (mm.) | (in.) | (mm) | (in.) | (mm) | (in.) | (mm) | (in.) | (mm) |
| BW60-1812-75 | 11.74 | 298 | 0.875 | 22.2 | 0.68 | 17 | 1.75 | 44.5 | 9.4 | 239 |

BW60-1812 Home Drinking Water elements seal at a standard 2.0 inch – 2.05 inch I.D. within pressure vessels

Figure 1: Impact of Pressure on Permeate Flow (constant temperature, recovery)


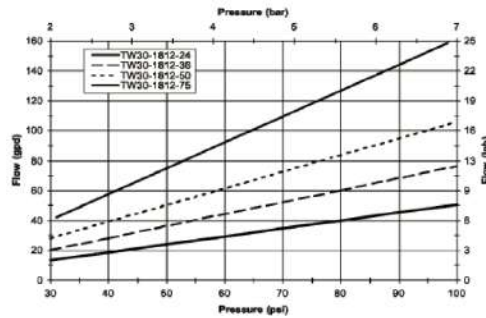


Figure 2: Impact of Temperature on Permeate Flow (constant temperature, recovery)

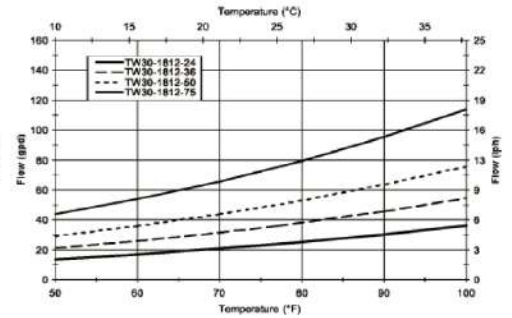

Operating and Cleaning Limits

| | |
|---|-------------------|
| Maximum Operating Temperature ^a | 113°F (45°C) |
| Maximum Operating Pressure | 150 psig (10 bar) |
| Maximum Feed Flow Rate | 2.0 gpm (7.6 lpm) |
| pH Range, Continuous Operation ^a | 2 – 11 |
| Maximum Feed Silt Density Index (SDI) | SDI 5 |
| Free Chlorine Tolerance ^b | < 0.1 ppm |

- a. Maximum temperature for continuous operation above pH 10 is 95°F (35°C).
- b. Under certain conditions, the presence of free chlorine and other oxidizing agents will cause premature membrane failure. Since oxidation damage is not covered under warranty, DuPont Water Solutions recommends removing residual free chlorine by pretreatment prior to membrane exposure. Please refer to technical bulletin "[Dechlorinating Feedwater](#)" for more information.

Additional Important Information

- It is recommended that systems using these elements rinse the elements for 24 hours, prior to first use, to meet NSF/ANSI 58 Standard.
- Permeate water obtained from the first hour of use should be discarded to the drain.
- To ease installation, it is recommended to use a lubricant safe for indirect water contact on all seals. Potential options include water, glycerin based lubricants, and MOLYKOTE® 111 Compound.
- Rotate the element about a quarter turn to ease installation and removal of the element. Ensure good interface between the o-rings and brine seal with their connection surfaces.
- Keep elements moist at all times after initial wetting.
- To prevent biological growth during prolonged system shutdowns, it is recommended that membrane elements be immersed in a preservative solution. Rinse out the preservative before use.
- The membrane shows some resistance to short-term attack by chlorine (hypochlorite). Continuous exposure, however, may damage the membrane and should be avoided.
- FILMTEC™ Home Drinking Water Reverse Osmosis Elements may be covered under the FILMTEC™ Reverse Osmosis and Nanofiltration Element Three-Year Prorated Limited Warranty, 609-35010-1006 extended to OEMs. Such Limited Warranty is non-transferable. Contact a DuPont representative for more information.

If operating limits and guidelines given in this Product Information Bulletin are not strictly followed, the Limited Warranty will be null and void. The OEM is fully responsible for the effects of incompatible chemicals and lubricants on elements. Use of any such chemicals or lubricants will void the Limited Warranty.

Product Stewardship

DuPont has a fundamental concern for all who make, distribute, and use its products, and for the environment in which we live. This concern is the basis for our product stewardship philosophy by which we assess the safety, health, and environmental information on our products and then take appropriate steps to protect employee and public health and our environment. The success of our product stewardship program rests with each and every individual involved with DuPont products— from the initial concept and research, to manufacture, use, sale, disposal, and recycle of each product.

Customer Notice

DuPont strongly encourages its customers to review both their manufacturing processes and their applications of DuPont products from the standpoint of human health and environmental quality to ensure that DuPont products are not used in ways for which they are not intended or tested. DuPont personnel are available to answer your questions and to provide reasonable technical support. DuPont product literature, including safety data sheets, should be consulted prior to use of DuPont products. Current safety data sheets are available from DuPont.

Please be aware of the following:

- The use of this product in and of itself does not necessarily guarantee the removal of cysts and pathogens from water. Effective cyst and pathogen reduction is dependent on the complete system design and on the operation and maintenance of the system.
- Permeate obtained from the first hour of operation should be discarded (or in a few cases: Any concentrate or permeate obtained from the first hour of operation should be discarded).

Regulatory Note

These membranes may be subject to drinking water application restrictions in some countries: please check the application status before use and sale.

Have a question? Contact us at:

www.dupont.com/water/contact-us

All information set forth herein is for informational purposes only. This information is general information and may differ from that based on actual conditions. Customer is responsible for determining whether products and the information in this document are appropriate for Customer's use and for ensuring that Customer's workplace and disposal practices are in compliance with applicable laws and other government enactments. The product shown in this literature may not be available for sale and/or available in all geographies where DuPont is represented. The claims made may not have been approved for use in all countries. Please note that physical properties may vary depending on certain conditions and while operating conditions stated in this document are intended to lengthen product lifespan and/or improve product performance, it will ultimately depend on actual circumstances and is in no event a guarantee of achieving any specific results. DuPont assumes no obligation or liability for the information in this document. References to "DuPont" or the "Company" mean the DuPont legal entity selling the products to Customer unless otherwise expressly noted. NO WARRANTIES ARE GIVEN; ALL IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE ARE EXPRESSLY EXCLUDED. No freedom from infringement of any patent or trademark owned by DuPont or others is to be inferred.

DuPont™, the DuPont Oval Logo, and all products, unless otherwise noted, denoted with a ™, ™, or ® are trademarks, service marks or registered trademarks of affiliates of DuPont de Nemours Inc. Copyright © 2019 DuPont de Nemours Inc. All rights reserved.

